


Victor Products Ltd  
Unit 3A, Tyne Dock East Side  
Port of Tyne,  
South Shields,  
Tyne and Wear  
NE33 5SQ  
United Kingdom  
Tel : +44(0)191 2808000  
Fax : +44(0)191 2808080



## Making Hazardous Environments Work


### 3.3kV BLANKING COVER – TYPE 33IECA

**Certification number MECS02ATEX5091U**  I M2 Ex db I Mb

**Certification number BAS21UKEX0324U**  I M2 Ex db I Mb

The certificates carries the group and category marking: - I M2

Where: I signifies suitability for use in mining and M2 signifies suitability for use in mines where it must be de-energised in the presence of an explosive atmosphere.

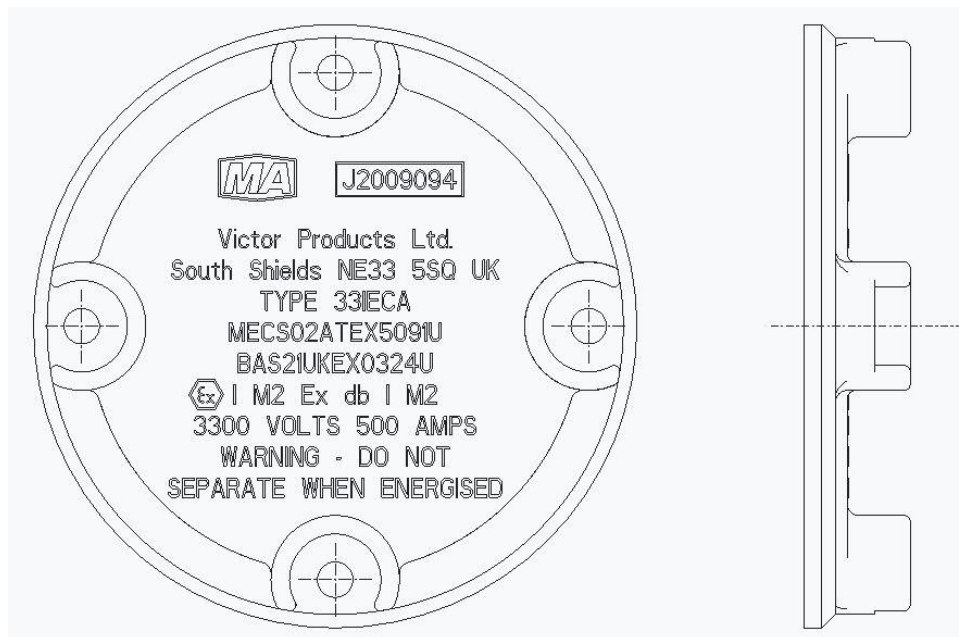

#### GENERAL.

1. This Blanking Cover Type No. 33IECA, certificates MECS02ATEX5091U and BAS22UKEX0324U can be associated with any 3.3Kv adaptor or half coupler that has an interface flange designed to BS3454.

For India only – The blanking cover has been designed in accordance with IS/IEC 60079-0:2004 and IS/IEC 60079-1:2007. Test report number CIMFR/TC/C/H329.

2. Installation must be carried out by suitably qualified personnel in accordance with established codes of practice.

## **ASSEMBLY.**

1. The protective blanking cardboard cover and retaining must be removed prior to assembly with the mating part, after which it should be disposed of in safe and proper manner.
2. During assembly it is extremely important that the FLP face on the cover and the FLP face on the mating component are not damaged and are free from any objects which may cause damage during assembly.
3. Assembly to the mating component is achieved by use of the following fasteners:-
  - 4 – off M8 hexagon headed screws x 50 long, steel grade 8.8 min. to ISO 272.
  - 4 – off M8 hexagon nuts, steel grade 8 min. to ISO 272.
  - 4 – off 8 I.D. spring washers.

## **MAINTENANCE AND INSPECTION.**

1. It should be noted that no parts in this end cover are replaceable. This end cover is fitted with an inner insulating disc and should not be used without the disc.
2. After assembly the gap between the 2 mating faces should be checked using feeler gauges and should not exceed 0.5mm.

## **HEALTH AND SAFETY AT WORK etc. ACT 1974**

In the United Kingdom all equipment must be installed, operated and disposed of (as required) within the legislative requirements of the Health and Safety at Work etc. Act 1974. Leaflet No. HSS L1 refers to the Company's obligation and is available on request.

It is the responsibility of the user to select, install, operate and maintain the equipment in accordance with the relevant legislation and appropriate code of practice.



Prices and design are subject to alteration without notice. All products are sold subject to our conditions of sale, copies of which are available on request.

*We reserve the right to change characteristics of our products. All data is for guidance only*

# UK Attestation of Conformity




Victor Products Ltd  
Unit 3A, Tyne Dock East Side  
Port of Tyne,  
South Shields,  
Tyne and Wear  
NE33 5SQ  
United Kingdom

## 3.3kV BLANKING COVER – TYPE 33IECA

Certification number BAS21UKEX0324U  I M2 Ex db I Mb

Victor Products Ltd

Hereby declare our sole responsibility that the product which is the subject of this attestation is in conformity with the following standards or normative documents.

Number and date of standard	UK Legislation
BS EN IEC 60079-0:2018 BS EN 60079-1:2014	Equipment and Protective Systems Intended for use in Potentially Explosive Atmospheres Regulations 2016
EN50082 (1992) EN55015 (1993) EN 60555-2 (1987)	89/336 EEC: Electromagnetic Comptability
<b>Notified Body:</b> Sira Certification Services CSA Group Deeside CH5 3US Notified Body No. 0518	 P. Devlin Operations Manager January 2024

SERIAL NUMBER

# Attestation of Conformity

Attestation de Conformité  
Konformitätsbescheinigung



Victor Products Ltd  
Unit 3A, Tyne Dock East Side  
Port of Tyne,  
South Shields,  
Tyne and Wear  
NE33 5SQ  
United Kingdom

## 3.3kV BLANKING COVER – TYPE 33IECA


Certification number **MECS02ATEX5091U**  **I M2 Ex db I Mb**

### Victor Products Ltd

Hereby declare our sole responsibility that the product which is the subject of this attestation is in conformity with the following standards or normative documents.

Erklären in alleiniger Verantwortung, daß das Product auf das sich diese Bescheinigung bezieht, mit der/den folgenden Norm(en) oder normativen Dokumenten Ubereinstimmt.

Déclarons de notre seule responsabilité, que le produit auquel cette attestation se rapporte, est conforme aux norme(s) ou aux documents normatifs suivants.

<b>Number and date of standard</b> Nr. Sowie Ausgabedatum der Norm No. Ainsi que date d'émission des normes.	<b>Directive description</b> Bestimmungen der Richtlinie Prescription de la directive
BS EN IEC 60079-0:2018 BS EN 60079-1:2014	<b>Equipment and protective systems intended for use in potentially explosive atmospheres.</b> This Attestation is valid for directive 2014/34/EU.  Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen. Diese Bescheinigung gilt für die Richtlinie 2014/34 /EU.  Appareils et systèmes de protection destinés a être utilisés en atmosphères explosibles. Cette Attestation est valable pour la directive 2014/34 /UE.
EN50082 (1992) EN55015 (1993) EN 60555-2 (1987)	<b>89/336 EEC: Electromagnetic Comptability</b>  89/336 EWG: Elektromagnetische Verträglichkeit  89/336 CEE: Comptabilité électromagnétique
<b>Notified Body:</b> CSA Group Netherlands B.V. Notified Body No. 2813	  P. Devlin Operations Manager January 2024

SERIAL NUMBER