

Victor Products Ltd
 Unit 3A, Tyne Dock East Side
 Port of Tyne,
 South Shields,
 Tyne and Wear
 NE33 5SQ
 United Kingdom
 Tel : +44(0)191 2808000
 Fax : +44(0)191 2808080



Making Hazardous Environments Work


11kV BLANKING COVER – TYPE CCEX1A

ATEX Certification Number	MECS02ATEX5184U I M2 Ex db I Mb
UKEX Certification Number	BAS22UKEX0170U I M2 Ex db I Mb

The certificates carries the group and category marking:- I M2

Where: **I** signifies suitability for use in mining and **M2** signifies suitability for use in mines where it must be de-energised in the presence of an explosive atmosphere.

For India only – The blanking cover has been designed in accordance with IS/IEC 60079-0:2004 and IS/IEC 60079-1:2007. Test report number ERTL (E)/TES/V051/0079/11-11.

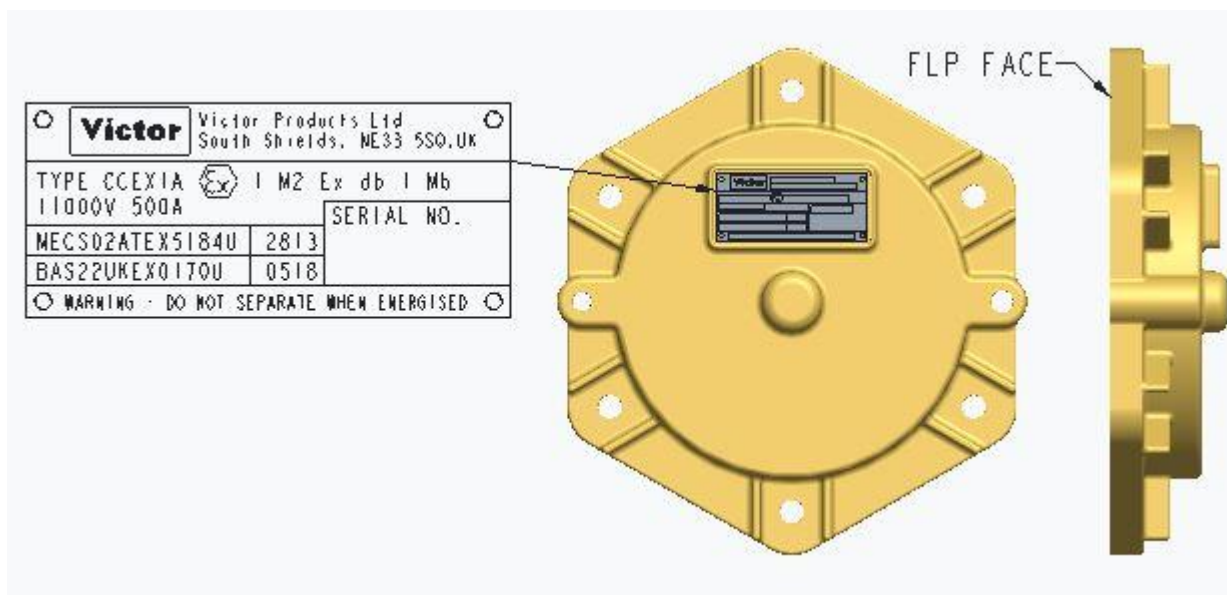

Note - It is the end users responsibility to follow the installation roles protecting other equipment energized via the connectors against the hazards arising from power failures.

Installation, maintenance, and inspection, must be carried out by suitably qualified personnel in accordance with established codes of practice.

GENERAL.


1. This Blanking Cover Type No. CCEX1A certificate, MECS02ATEX5184U can be associated with any 11kV adaptor or half coupler that has an interface flange with identical fastening criteria.
2. Installation must be carried out by suitably qualified personnel in accordance with established codes of practice.

ASSEMBLY.


1. The protective blanking cardboard cover (if fitted) must be removed prior to assembly with the mating part, after which it should be disposed of in safe and proper manner.
2. During assembly it is extremely important that the FLP face on the cover and the FLP face on the mating component are not damaged and are free from any objects which may cause damage during assembly.

MAINTENANCE AND INSPECTION.

1. It should be noted that no parts in this end cover are replaceable. This end cover is fitted with an inner insulating disc and should not be used without the disc.
2. When assembled to an adaptor or half coupler a rubber sealing ring must be used between the two interface flanges, with the flanges secured by using the inter-connecting kit. After assembly the gap between the two mating faces should be checked using feeler gauges and should not exceed 0.4mm.

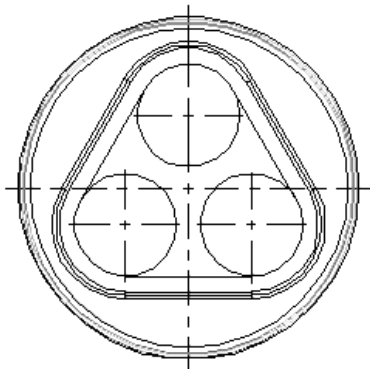

TYPICAL SEALING RING



INTER-CONNECTING NUT ASSEMBLY

HEALTH AND SAFETY AT WORK etc. ACT 1974

In the United Kingdom all equipment must be installed, operated and disposed of (as required) within the legislative requirements of the Health and Safety at Work etc. Act 1974. Leaflet No. HSS L1 refers to the Company's obligation and is available on request.

It is the responsibility of the user to select, install, operate and maintain the equipment in accordance with the relevant legislation and appropriate code of practice.



EU Only

Prices and design are subject to alteration without notice. All products are sold subject to our conditions of sale, copies of which are available on request.

We reserve the right to change characteristics of our products. All data is for guidance only

UK Attestation of Conformity




Victor Products Ltd
Unit 3A, Tyne Dock East Side
Port of Tyne,
South Shields,
Tyne and Wear
NE33 5SQ
United Kingdom

11kV HALF END COVER – TYPE CCEX1A

Certification number BAS22UKEX0170U I M2 Ex db I Mb

Victor Products Ltd

Hereby declare our sole responsibility that the product which is the subject of this attestation is in conformity with the following standards or normative documents.

Number and date of standard	UK Legislation
BS EN IEC 60079-0:2018 BS EN 60079-1:2014	Equipment and Protective Systems Intended for use in Potentially Explosive Atmospheres Regulations 2016
EN50082 (1992) EN55015 (1993) EN 60555-2 (1987)	2014/30/EU: Electromagnetic Compatibility
UK Approval Body: CSA Group Testing UK Ltd Deeside CH5 3US Notified Body No. 0518	 P. Devlin Operations Manager January 2024

SERIAL NUMBER

Attestation of Conformity

Attestation de Conformité
Konformitätsbescheinigung



Victor Products Ltd
Unit 3A, Tyne Dock East Side
Port of Tyne,
South Shields,
Tyne and Wear
NE33 5SQ
United Kingdom


11kV BLANKING COVER – TYPE CCEX1A Certification number MECS02ATEX5184U I M2 Ex db I Mb

Victor Products Ltd

Hereby declare our sole responsibility that the product which is the subject of this attestation is in conformity with the following standards or normative documents.

Erklären in alleiniger Verantwortung, daß das Product auf das sich diese Bescheinigung bezieht, mit der/den folgenden Norm(en) oder normativen Dokumenten Ubereinstimmt.

Déclarons de notre seule responsabilité, que le produit auquel cette attestation se rapporte, est conforme aux norme(s) ou aux documents normatifs suivants.

Number and date of standard Nr. Sowie Ausgabedatum der Norm No. Ainsi que date d'émission des normes.	Directive description Bestimmungen der Richtlinie Prescription de la directive
BS EN IEC 60079-0:2018 BS EN IEC 60079-1:2014	Equipment and protective systems intended for use in potentially explosive atmospheres. This Attestation is valid for directive 2014/34/EU. Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung in explosionsgefährdeten Bereichen. Diese Bescheinigung gilt für die Richtlinie 2014/34 /EU. Appareils et systèmes de protection destinés a être utilisés en atmosphères explosibles. Cette Attestation est valable pour la directive 2014/34 /UE.
EN50082 (1992) EN55015 (1993) EN 60555-2 (1987)	89/336 EEC: Electromagnetic Compatability 89/336 EWG: Elektromagnetische Verträglichkeit 89/336 CEE: Compatibilité électromagnétique
Notified Body: CSA Group Netherlands B.V. Notified Body No. 2813	 P. Devlin Operations Manager January 2024

SERIAL NUMBER